

## A Power Quality analyser and fault recorder

### Model PQI-DA smart

- ▶ Wall-mounted housing
- ▶ DIN-Rail housing
- ▶ Panel mounting housing



## 1. Application

Solving all measurement tasks in electrical grids can be a daunting task. The new Power Quality Interface and Disturbance Recorder *PQI-DA smart*, aimed at low, medium and high voltage grids, represents the A-Eberle response to such needs. This central component can be used either as Power Quality-Interface in accordance with all Power Quality standards or as a device for all physically defined/measured values in typical three-phase systems.

Beside the possibility of standard evaluations, the *PQI-DA smart* also has a high speed fault recorder capability with a 40.96kHz/10.24kHz recording rate and a half cycle r.m.s. registration, which allows for a detailed analysis of grid disturbances.

In particular, *PQI-DA smart* is suitable for monitoring, registering, evaluating and recording special reference quantities or quality agreements between the supplier of energy and the end customer. In addition, the device can provide many measured values in parallel for SCADA applications via standardized interfaces such as Modbus.

Modern voltage quality measuring instruments operate according to the IEC 62586 standard, which describes the complete product characteristic of a Power Quality Analyser. This standard defines not only the purpose of use, the EMC environment, the environmental conditions, but also the exact measurement methods (IEC 61000-4-30) in order to create a comparable basis for the user.

Devices from different manufacturers operating according to this standard, must offer the same measurement results.

According to IEC 62586, the *PQI-DA smart* is a device PQI-A-FI-H and has therefore been fully certified in external laboratories.

The *PQI-DA smart* meets all demands of the IEC 61000-4-30 Ed.3 (2015) standard for an A-Class device:

Parameter IEC61000-4-30	Class
Power frequency	A
Magnitude of the Supply Voltage	A
Flicker	A
Supply voltage dips and swells	A
Voltage interruptions	A
Supply voltage unbalance	A
Voltage harmonics	A
Voltage interharmonics	A
Mains signalling voltage	A
Underdeviation and overdeviation	A
Measurement aggregation intervals	A
Time-clock uncertainty	A
Flagging	A
Transient influence quantities	A

## 2. Design

The *PQI-DA smart* has been developed for measurements performed within public grids as well as for recording PQ data within an industrial environment up to 690V (L-L) measurement voltage. Its key characteristics, making it suitable for such environments, are:

- No moving parts (fans, hard drives etc.)
- CAT IV
- Extensive storage capability (can be extended up to 32 GB by the user, permitting several years recording without connection to database)
- **Optional "IEC61000-4-7 - 2kHz to 9kHz" (B1)**
- Frequency measurement of voltage and current according IEC 61000-4-7 from 2 kHz to 9 kHz.

### 2.1 Characteristics of the Power-Quality Interface *PQI-DA smart*

#### 2.1.1 Technical Data

- 1.7-inch colour display
- Keypad for basic/direct device configuration
- 1 GB internal memory
- Input channel bandwidth 20 kHz
- 4 voltage inputs  
FSR : 480V L-N, Accuracy < 0.1%
- 4 current inputs
  - 1A/5A nominal, 500A max current for 1 sec.
  - 1V voltage input for current clamps
- Simultaneous processing of sampled and calculated voltages and currents
- Oscilloscopic voltage and current recorder sampling rate : 40.96kHz / 10.24kHz
- Half cycle recorder :
  - power frequency, r.m.s. of voltages and currents, voltage and current phasors, power recording rate : ~10ms(50Hz) / ~8.33ms (60Hz)
- Powerful recorder triggering
- Online streaming of voltages and currents at 40.96 kHz sampling rate.
- IEC 61000-4-30, Class A voltage quality processing
- Recording of DIN EN 50160 power quality events
- Spectral analysis 2 kHz...9 kHz,(35 frequency bands, BW = 200Hz) of voltages and currents according (IEC 61000-4-7)
- Phase of voltage and current harmonics n=2..50
- 2 general purpose digital inputs (Trigger, Recording Start / Stop, General documentation of level)

- 2 relay outputs for protection monitoring and alarm
- Complex analysis software WinPQ lite (sold as a package)
- **As an option:** Analysis of the data on an MYSQL-based database using the WinPQ software package. Permanent communication and evaluation of the data with many devices in parallel.

#### Communication Protocols

- MODBUS RTU
- MODBUS TCP
- IEC60870-5-104 (Option P1)
- IEC61850 (Option P2)

#### Time synchronisation protocols (Receive / Slave)

- IEEE1344 / IRIG-B000..007
- GPS (NMEA +PPS)
- DCF77
- NTP

#### Interfaces

Ethernet	RJ45 (10/100 Mbit)
2 * RS232/RS485 on terminals	switchable

#### Dimensions

L x B x H	160 x 90 x 58 mm
-----------	------------------

#### Weight

Weight	502g
--------	------

<b>Voltage inputs</b>		<b>E00</b>	<b>Voltage inputs</b>		<b>E00</b>	
Channels	U <sub>1</sub> , U <sub>2</sub> , U <sub>3</sub> , U <sub>N/E/4</sub>			@ 100%..150%Un		
Electrical safety DIN EN 61010	300V CAT IV 600V CAT III		Interruption duration	±20ms @ 1%..100%Un		
Input reference level	PE		Voltage unbalance	±0.15% @ 1%..5% reading		
Impedance -> PE	10 MΩ    25pF		Mains signalling voltage (< 3kHz)	±5% of reading @ Us = 3%..15% Un ±0.15% Un @ Us = 1%..3% Un		
Nominal input voltage Un	230VAC					
Full scale range (FSR)	0...480VAC L-E					
Waveform	AC & DC, any					
Maximum crest factor @ Un	3					
Bandwidth	DC...20kHz					
Nominal power frequency fn	50Hz / 60Hz					
Frequency range of the fundamental	fn ± 15% 42.5..50..57.5Hz 51.0..60..69.0Hz					
<b>Accuracy</b>						
Fundamental, r.m.s	±0.1% Un (0°C...45°C)  ±0.2% Un (-25°C...55°C) @ 10%...150%Un		Input type	Differential, isolated		
			Impedance	≤ 4mΩ		
			Nominal input current In	5 A <sub>AC</sub>		
Fundamental, Phase	±0.01° @ 10%...150%Un		Full scale range (FSR)	10A <sub>AC</sub>	100A <sub>AC</sub>	
Harmonics n = 2..50, r.m.s.	±5% of reading @ Uh ≥ 1% Un  ±0.05% Un @ Uh < 1% Un		Overload capacity permanent ≤ 10s ≤ 1s	20 A 100 A 500 A		
Harmonics n = 2..50, Phase	±n·0.01° @ Uh ≥ 1% Un		Waveform	AC, any		
Interharmonics n = 1..49, r.m.s.	±5% of reading @ Uih = ≥ 1% Un  ±0.05% Un @ Uih < 1% Un		Maximum crest factor @ In	4		
Power frequency	±1mHz @ 10%...200%Un		Bandwidth	25Hz...20kHz		
Flicker DIN EN 61000-4-15:2011	Class F2		<b>Accuracy</b>			
Dip residual voltage	±0.2% Un @ 10%..100%Un		Fundamental, r.m.s	< 0,1% FSR 5%...100%	< 0,2% FSR 5% ... 10%	
Dip duration	±20ms @ 10%..100%Un		Fundamental, Phase	±0,1° 5%...100%	±0,2° 5% ... 10%	
Swell residual voltage	±0.2% Un @ 100%..150%Un		Harmonics n = 2..50, r.m.s.	5% 5%...100%	10% 5% ... 10%	
Swell duration	±20ms		Harmonics n = 2..50, Phase	±n·0,1° 5%...100%	±n·0,2° 5% ... 10%	
			Interharmonics n = 1..49, r.m.s.	±5% 5%...100%	±10% 5% ... 10%	

We take care of it.

Current inputs (Rogowski coil 1V) – Feature C40		
Option	C40	Binary outputs (BO)
Channels	I1, I2, I3, IN/4	2 binary outputs 1 x closer 1 x changeover
Impedance	1MΩ	Contact specification (EN60947-4-1, -5-1) : Configuration Nominal voltage Nominal current Nominal load AC1 Nominal load AC15, 230VAC Interrupting power DC1, 30/110/220 V
Input range	0.35V <sub>AC</sub>	1 x SPST (Single Pole Single Throw) 1 x SPDT (Single Pole Double Throw) 250VAC 6 A 1500 VA 300 VA
Bandwidth	DC...20kHz	6/0.2/0.12 A
AC Requirements	galvanic isolated	
Current inputs (current clamps)		
Feature	C44	C45
Channels	I1, I2, I3, IN/4	
Impedance	1MΩ	1MΩ
Input range	0,5 V <sub>AC</sub>	5,6 V <sub>DC</sub>
Bandwidth	DC...20kHz	
AC Requirements	galvanic isolated	
Power Supply		
Feature	H1	H2
AC Nominal range [V]	100...240	-
AC Operating range [V]	90...264	-
DC Nominal range [V]	110...320	24...60
DC Operating range [V]	100...350	18...75
Power consumption	≤ 10 W < 20 VA	≤ 10 W
Storage of measured values		
Internal memory	1024 MB	
SD memory card	1 GByte to 32 GByte	
Binary inputs (BI)		
Feature	M1	M2
2 binary inputs	0 V..250 V <sub>AC</sub>	0 V...48 V <sub>DC</sub>
Range	/V <sub>DC</sub>	
– H – Level	> 35 V	> 10V
– L – Level	< 20 V	< 5V
Signal frequency	DC ... 70 Hz	DC ... 70 Hz
Input resistance	> 100 kΩ	6.8 kΩ
Electrical isolation	Optocoupler, electrically isolated	
Electrical safety DIN EN 61010	300V	

<b>Environmental parameters</b>	<b>Storage and transport</b>	<b>Operation</b>
Ambient temperature : Limit range of operation	IEC 60721-3-1 / 1K5 -40 ... +70°C IEC 60721-3-2 / 2K4 -40 ... +70°C	IEC 60721-3-3 / 3K6 -25 ... +55°C
Ambient temperature : Rated range of operation H1 Rated range of operation H2	---	IEC DIN EN 61010 -25 ... +45°C -25 ... +50°C
Relative humidity: 24h average No condensation or ice	5...95 %	5...95 %
Solar radiations	---	700W/m2
Vibration, earth tremors	IEC 60721-3-1 / 1M1 IEC 60721-3-2 / 2M1	IEC 60721-3-3 / 3M1

### Electrical safety

- IEC 61010-1
- IEC 61010-2-030

Protection class	1
Pollution degree	2
Overvoltage category mains supply option : H1 H2	300V / CAT III 150V / CAT III
Measurement category	300V / CAT IV 600V / CAT III
Altitude	≤ 2000m

### Electromagnetic Compatibility

#### Immunity

- IEC 61000-6-5, environment H

#### Emissions


- CISPR22 (EN 55022) , class A

### 2.1.2 Mechanical design


The *PQI-DA smart* is mountable on the wall or via its DIN rail housing.

All connections are accessible via Phoenix type terminals. The connections are made by using plug-in/clamping technology, except for the current and voltage inputs.

For the TCP/IP interface one RJ 45-connector is available.

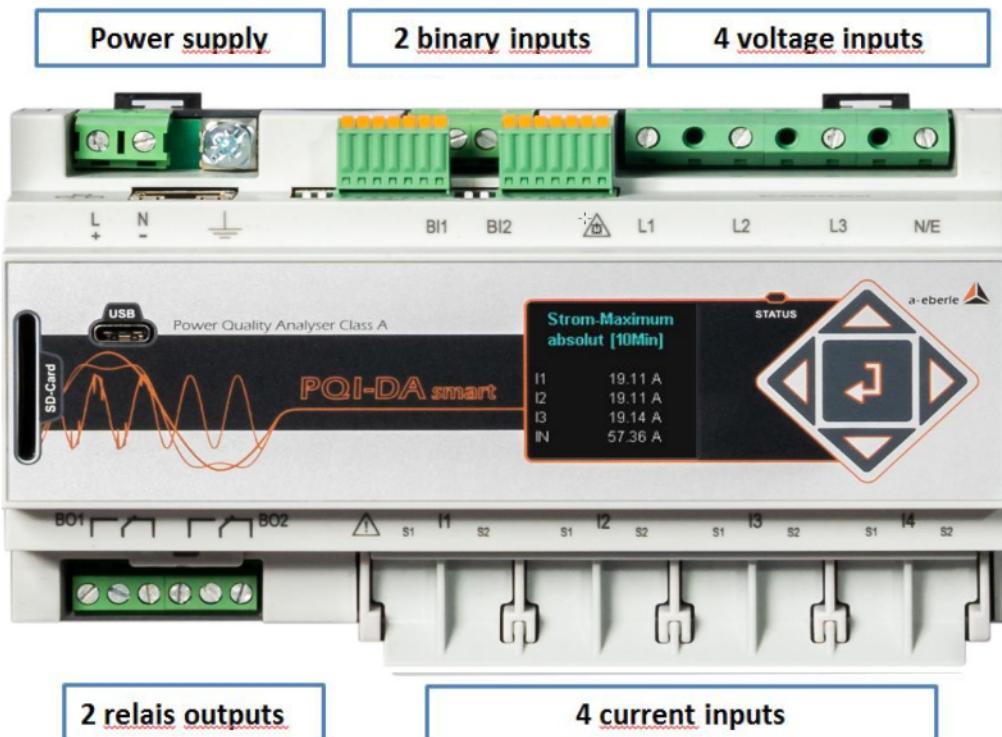


Front view *PQI-DA smart*

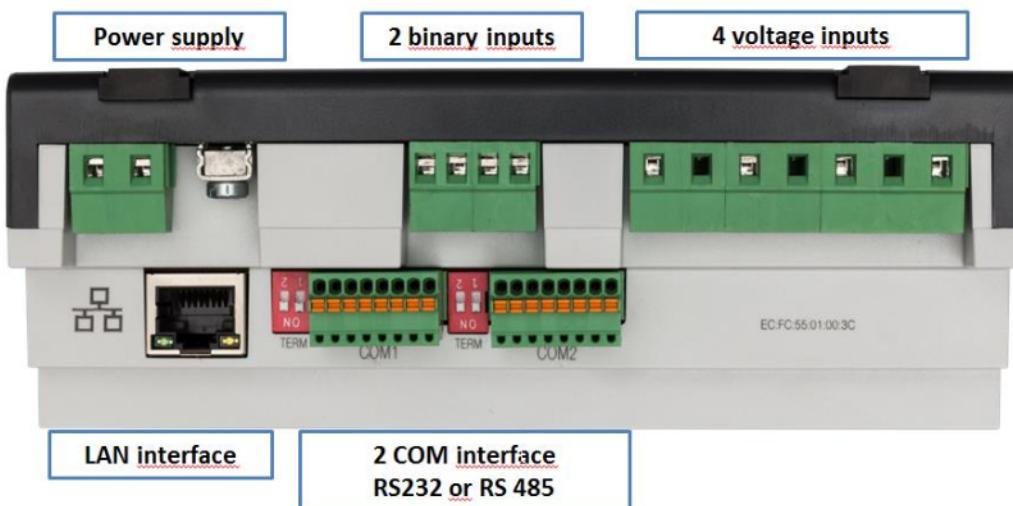


Side view of *PQI-DA smart*

### 2.1.3 Terminal strip number PQI-DA smart

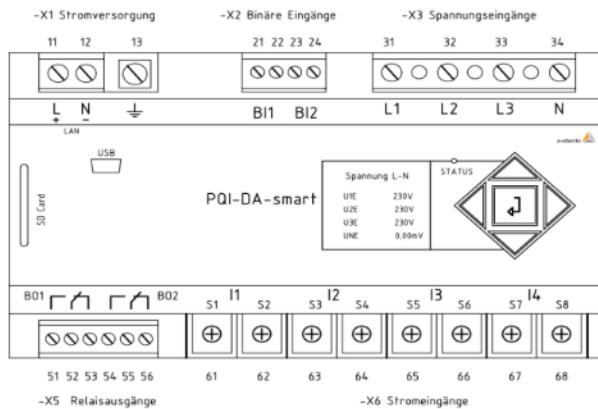

Terminal strip no.	Designation	Function	Terminal no.
X1	Auxiliary voltage	U <sub>H</sub>	L (+) 11 L (-) 12
X1	Ground	GND	E 13
X2	Binary input (M1/M2)	BI1 BI2	+ 21 - 22 + 23 - 24
X3	Phase voltage	U <sub>1</sub>	L1 31
	Phase voltage	U <sub>2</sub>	L2 32
	Phase voltage	U <sub>3</sub>	L3 33
	Neutral point voltage	U <sub>4</sub>	N 34
X5	Binary output 1	R1	NC contact 51 Pol 52 NO contact 53
	Binary output 2	R2	NC contact 54 Pol 55 NO contact 56
X6	Phase current L1	I <sub>1</sub>	S1 (K) 61 S2 (I) 62
	Phase current L2	I <sub>2</sub>	S1 (K) 63 S2 (I) 64
	Phase current L3	I <sub>3</sub>	S1 (K) 65 S2 (I) 66
	Neutral conductor / sum current	I <sub>4</sub>	S1 (K) 67 S2 (I) 68

## 2.1.4 Dimensions

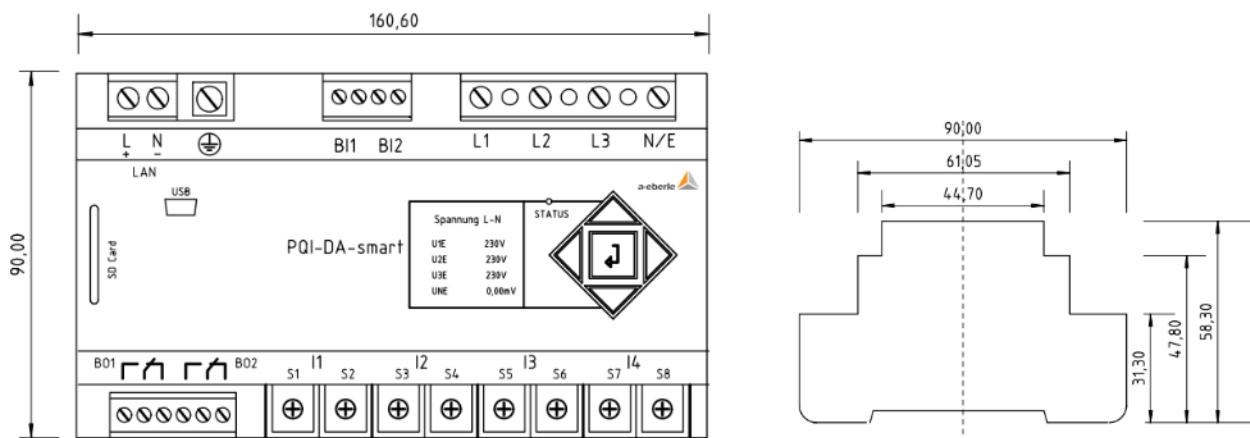

## 2.1.5 Colour display

The device's 1.7-inch colour display provides information about the correct connections for the measuring cables and current transducers, as well as it indicates online data on voltage, current, THD, power values and energy.

The number of PQ-events that occurred, the oscilloscope records and R.M.S. records for different periods (last day, week or month) are also displayed.



## 2.2 Measurement / Functions

*PQI-DA smart* complies with the automatic event detection and measurement standards, which are:

EN50160 (2013) / IEC61000-2-2 / IEC61000-2-12 /IEC61000-2-4 (Class 1; 2; 3) / NRS048 / IEEE519 / IEC61000-4-30 class A / IEC61000-4-7 / IEC61000-4-15

### Continuous Recording:

Five fixed and two variable measurement time intervals are available for continuous recording:

10/12 T (200ms), 1 sec, n\*sec, 150/180 T (3sec), n\*min, 10 min, 2 h

Time Interval Voltage	10/ 12T	150/ 180T	10 min	2 h	1 s	N* s	N* min
Power frequency	✓	✓	✓	✓	✓	✓	✓
Power frequency, 10s-Value (IEC61000-4-30)			✓				
Extremes, standard deviation of power frequency (10s)			✓				
r.m.s. values (IEC61000-4-30)	✓	✓	✓	✓	✓	✓	✓
Extremes, standard deviation of T/2-values			✓				
Underdeviation [%], Overdeviation [%] (IEC61000-4-30)	✓	✓	✓	✓			
Harmonic subgroups n= 0..50 (IEC61000-4-7)	✓	✓	✓	✓			
Maximum values of 10/12 T harmonic subgroups n = 2..50			✓				
Interharmonic subgroups n=0..49 (IEC61000-4-7)	✓	✓	✓	✓			
Total Harmonic Distortion (THDS) (IEC61000-4-7)	✓	✓	✓	✓	✓	✓	✓
Partial Weighted Harmonic Distortion (PWHD)	✓	✓	✓	✓	✓	✓	✓
Unbalance, negative-/positive- sequence , sequence sign	✓	✓	✓	✓	✓	✓	✓
Unbalance, zero-/positive- sequence	✓	✓	✓	✓	✓	✓	✓
Positive-, negative-, zero sequence phasors	✓	✓	✓	✓	✓	✓	✓
Phasors (fundamental)	✓	✓	✓	✓	✓	✓	✓
Flicker (IEC61000-4-15)			✓	✓			
Instant flicker (IEC61000-4-15)	✓		✓				
Mains signalling voltages [%] (IEC61000-4-30)	✓	✓					
Phase angle( zero crossings) of phase voltage harmonics n=2..50 to fundamental of reference voltage	✓	✓	✓	✓			
Frequency bands 1..35 , 2kHz..9kHz, r.m.s. (IEC61000-4-7)			✓	✓	✓	✓	✓

<b>Time Interval Current</b>	<b>10/ 12T</b>	<b>150/180T</b>	<b>10 min</b>	<b>2 h</b>	<b>1 s</b>	<b>N* s</b>	<b>N* min</b>
r.m.s. values	✓	✓	✓	✓	✓	✓	✓
Extremes of T/2-values			✓				
Harmonic subgroups n= 0..50 (IEC61000-4-7)	✓	✓	✓	✓			
Maximum values of 10/12 T harmonic subgroups n = 2..50			✓				
Interharmonic subgroups n=0..49 (IEC61000-4-7)	✓	✓	✓	✓			
Total Harmonic Distortion (THDS) (IEC61000-4-7)	✓	✓	✓	✓	✓	✓	✓
Total Harmonic Currents	✓	✓	✓	✓	✓	✓	✓
Partial Weighted Harmonic Distortion (PWHD)	✓	✓	✓	✓	✓	✓	✓
Partial Odd Harmonic Currents (PHC)	✓	✓	✓	✓	✓	✓	✓
K-Factors	✓	✓	✓	✓	✓	✓	✓
Unbalance, negative-/positive- sequence , sequence sign	✓	✓	✓	✓	✓	✓	✓
Unbalance, zero-/positive- sequence	✓	✓	✓	✓	✓	✓	✓
Positive-, negative-, zero sequence phasors	✓	✓	✓	✓	✓	✓	✓
Phasors (fundamental)	✓	✓	✓	✓	✓	✓	✓
Phase angle( zero crossings) of current harmonics n=2..50 to fundamental of reference voltage	✓	✓	✓	✓			
Frequency bands 1..35 , 2kHz..9kHz, r.m.s. (IEC61000-4-7)			✓	✓	✓	✓	✓


<b>Time Interval Energy</b>	<b>10 min</b>	<b>2 h</b>	<b>1 s</b>	<b>N* s</b>	<b>N* min</b>
Active energy, phase	✓	✓	✓	✓	✓
Active energy, total	✓	✓	✓	✓	✓
Exported active energy, phase	✓	✓	✓	✓	✓
Exported active energy, total	✓	✓	✓	✓	✓
Imported active energy, phase	✓	✓	✓	✓	✓
Imported active energy, total	✓	✓	✓	✓	✓
Reactive energy (inductive), phase	✓	✓	✓	✓	✓
Reactive energy (inductive), total	✓	✓	✓	✓	✓
Exported reactive energy (inductive), phase	✓	✓	✓	✓	✓
Exported reactive energy (inductive), total	✓	✓	✓	✓	✓
Imported reactive energy (inductive), phase	✓	✓	✓	✓	✓
Imported reactive energy (inductive), total	✓	✓	✓	✓	✓

Time Interval Power	10 min	2 h	1 s	N* s	N* min
Active power, phase	✓	✓	✓	✓	✓
Active power, total	✓	✓	✓	✓	✓
Active power extremes	✓				
Reactive power, phase	✓	✓	✓	✓	✓
Reactive power, total	✓	✓	✓	✓	✓
Reactive power extremes	✓				
Apparent power, phase	✓	✓	✓	✓	✓
Apparent power, total	✓	✓	✓	✓	✓
Fundamental active power, phase	✓	✓	✓	✓	✓
Fundamental active power, total	✓	✓	✓	✓	✓
Fundamental reactive power, phase	✓	✓	✓	✓	✓
Fundamental reactive power (displacement), total	✓	✓	✓	✓	✓
Fundamental apparent power, phase	✓	✓	✓	✓	✓
Phase angle of fundamental apparent power, phase	✓	✓	✓	✓	✓
Fundamental apparent power, total	✓	✓	✓	✓	✓
Phase angle of fundamental apparent power, total	✓	✓	✓	✓	✓
Reactive distortion power, phase	✓	✓	✓	✓	✓
Reactive distortion power, total	✓	✓	✓	✓	✓
Active power factors, phase, total	✓	✓	✓	✓	✓
Reactive power factors, phase, total	✓	✓	✓	✓	✓
COSφ + sign, phase, total	✓	✓	✓	✓	✓
SINφ + sign, phase, total	✓	✓	✓	✓	✓
COSφ + sign of reactive distortion power, phase, total	✓	✓	✓	✓	✓
Capacitive-, inductive scaling factor of COSφ (-1..0..+1) :	✓	✓	✓	✓	✓
Triggered interval mean active power, phase					
Triggered interval mean active power, total					
Triggered interval mean reactive power, phase					
Triggered interval mean reactive power, total					

## 2.3 Oscilloscopic recorder

Sampling rate: 40.96 kHz or 10.24 kHz  
 Max. Record length: 4s (40.96 kHz) or 16s (10.24 kHz)

Quantities	
3-wire system	4-wire system
phase – ground voltages	phase – neutral voltages
residual voltage	neutral – ground voltage
phase – phase voltages	
phase currents	
total current	neutral current

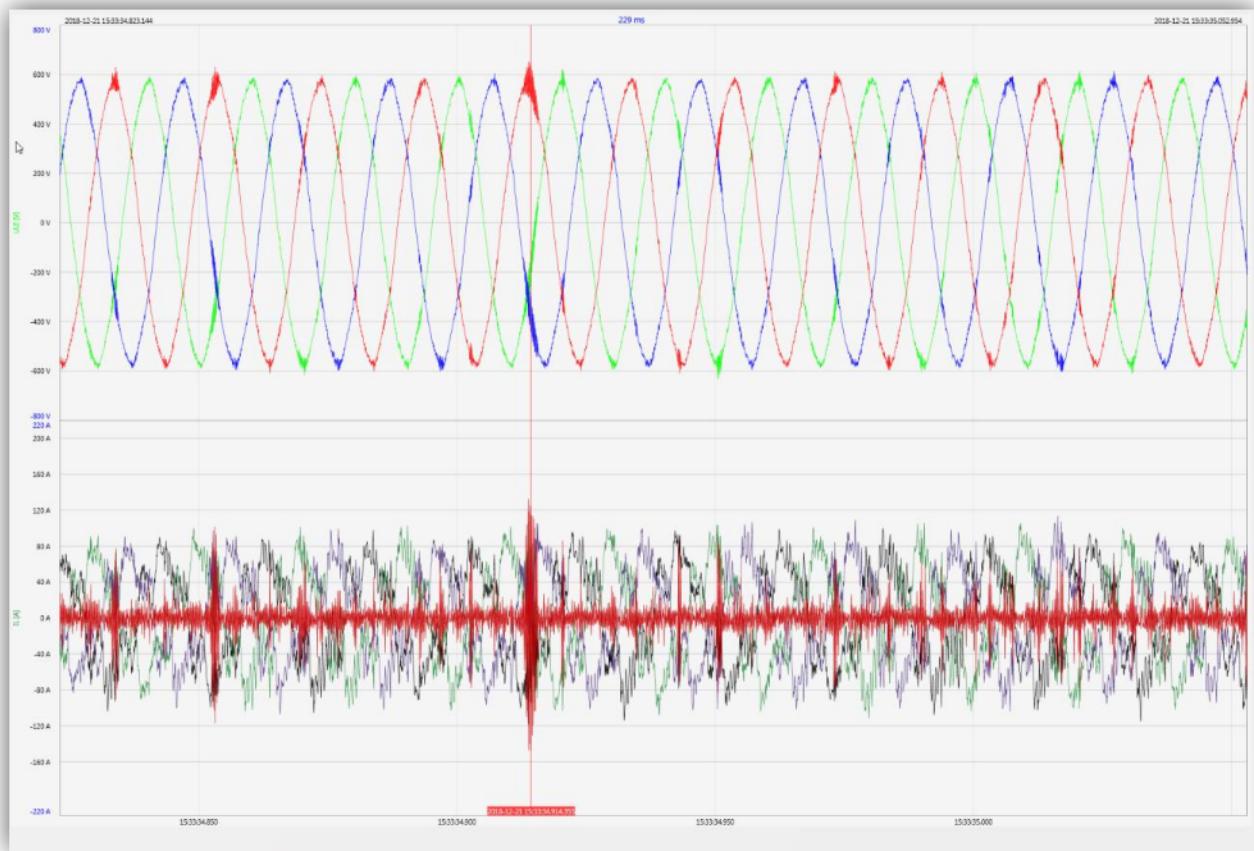


## 2.4 Half cycle recorder

Recording rate: ~10ms (50Hz) or ~8.333ms (60Hz)

Max. Record length: 6min (50Hz) or 5min (60Hz)

<b>Quantities</b>
Power frequency
r.m.s. voltages
r.m.s. currents
Active power, phase
Reactive power, phase
Active power, total
Fundamental reactive power (displacement), total
Phase angle of fundamental apparent power, total
Voltage phasors (fundamental)
Current phasors (fundamental)
Positive-, negative-, zero sequence voltage phasors
Positive-, negative-, zero sequence current phasors

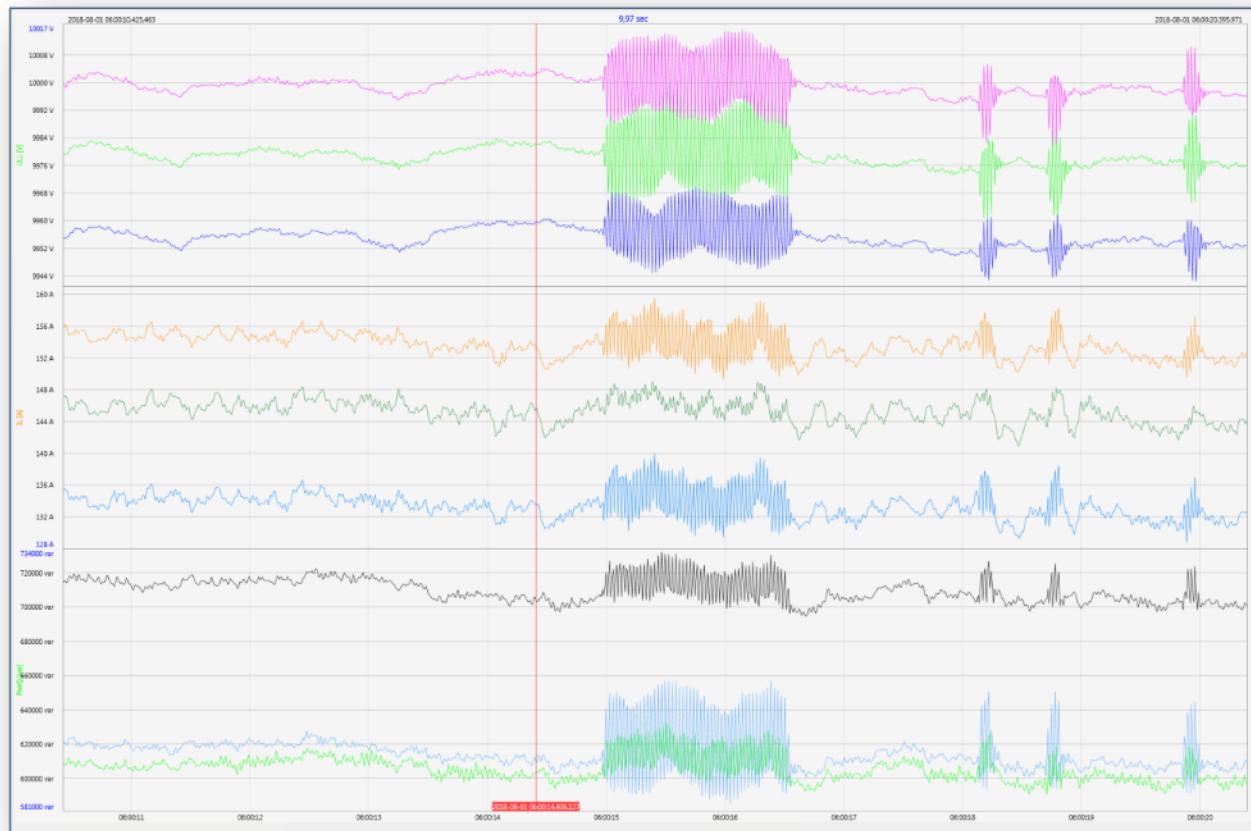

## 2.5 Recorder triggering

trigger quantity	lower	upper	step
r.m.s. phase voltages (T/2)	✓	✓	✓
r.m.s. phase-phase voltages (T/2)	✓	✓	✓
r.m.s. residual/neutral-ground voltage (T/2)		✓	✓
Positive sequence voltage (T/2)	✓	✓	
Negative sequence voltage (T/2)		✓	
Zero sequence voltage (T/2)		✓	
Phase voltage phase (T/2)			✓
phase voltages wave shapes (wave shape filter)			+/- threshold
phase-phase voltages wave shapes (wave shape filter)			
residual/neutral-ground voltage wave shape (wave shape filter)			
r.m.s. phase currents (T/2)	✓	✓	✓
r.m.s. total / neutral current (T/2)		✓	✓
Power frequency (T/2)	✓	✓	✓
Binary inputs (debounced)			rising, falling slope
Command			external

## 2.6 PQ Events:

trigger quantity	lower	upper
voltage dip (T/2)	✓	
voltage swell (T/2)		✓
voltage interruption (T/2)	✓	
voltage rapid voltage change (T/2)		sliding average filter mean +/- threshold
voltage change (10min)	✓	✓
voltage unbalance (10min)		✓
mains signalling voltage (150/180T)		✓
voltage harmonics (10min)		✓
voltage THD (10min)		✓
voltage short term flicker PST (10min)		✓
voltage long term flicker PLT (10min)		✓
power frequency (10s)	✓	✓

## 2.7 Online mode for direct readings

### Measurement / Functions

Oscilloscopic recorder


Voltage and current harmonics n=2..50

Voltage and current interharmonics n=0..49

Voltage and current harmonics 2-9kHz

Frequency spectra up to 20 kHz of voltages and currents

Online streaming of all data classes and all measured values

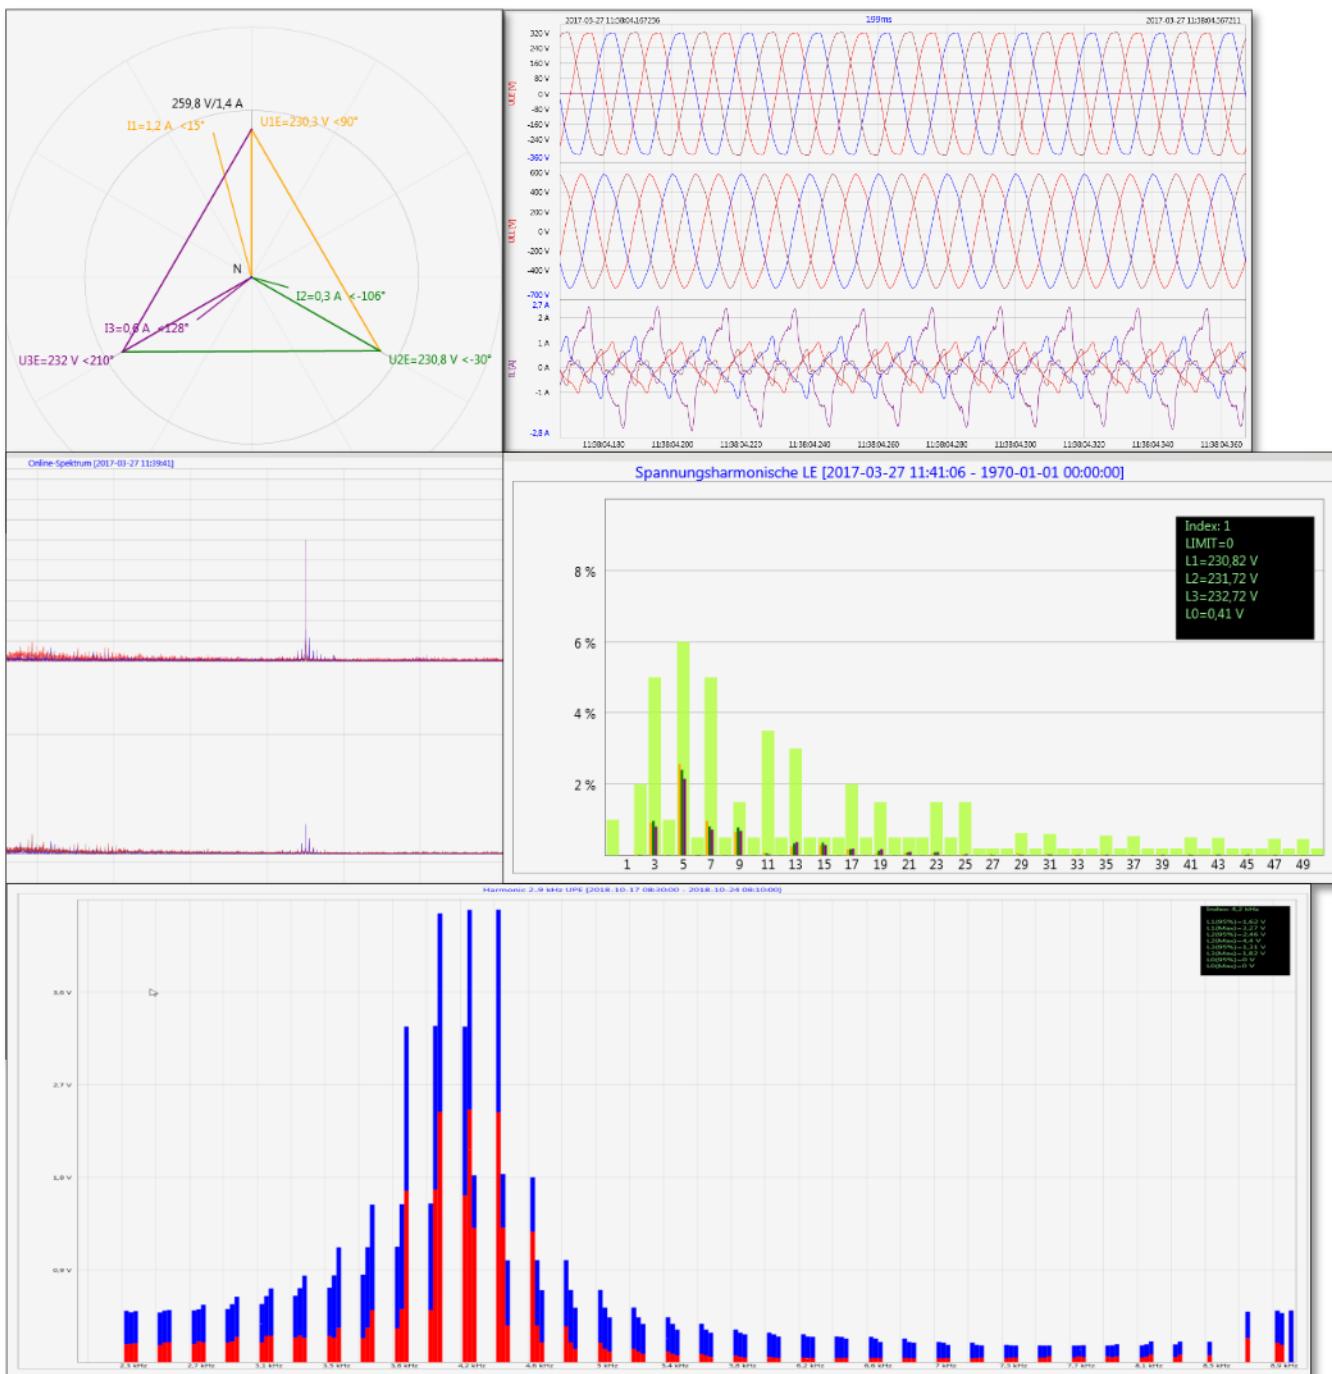

### 3. Order specifications *PQI-DA smart*

For determining the smart code ordering details:

- Only one unit can be ordered for codes with the same capital letter.
- When a code's capital letter is followed by the number 9, additional information in plain text is required.
- When a code's capital letter is followed only by zeros, the code may be omitted.

Characteristic	Code
Power Quality Interface and fault recorder <ul style="list-style-type: none"> <li>● 4 voltage converters, 4 current transformers</li> <li>● In accordance with DIN EN-50160 and IEC 61000-4-30 (Class A)</li> <li>● 2 digital inputs</li> <li>● 2 relay outputs</li> <li>● WinPQ lite software for <i>PQI-DA smart</i></li> </ul>	<i>PQI-DA smart</i>
Supply voltage <ul style="list-style-type: none"> <li>● AC 90 V..110 V..264 V or DC 100 V..220 V..350 V</li> <li>● DC 18 V...60 V...70 V</li> </ul>	H1 H2
Rated value of the input voltage <ul style="list-style-type: none"> <li>● 100V / 400 V / 690 V (CAT IV 300V)</li> </ul>	E00
Current inputs <ul style="list-style-type: none"> <li>● 4 current inputs for metering circuit 1A/5A (range 10A)</li> <li>● 4 current inputs for protection circuit 1A/5A (range 100A)</li> <li>● 4 current inputs for Rogowski Coils – Q4/2019</li> <li>● 4 AC current inputs for current clamps (0,5 V<sub>AC</sub>) – Q4/2019</li> <li>● 4 DC current inputs for current clamps (5,6 V<sub>DC</sub>) – Q4/2019</li> </ul>	C30 C31 C40 C44 C45
Binary inputs <ul style="list-style-type: none"> <li>● 2 programmable binary inputs (AC/DC 48..250V)</li> <li>● 2 programmable binary inputs (DC 10..48V)</li> </ul>	M1 M2
Option IEC61000-4-7 (40,96kHz sampling) <ul style="list-style-type: none"> <li>● 10,24kHz sampling; without 2kHz to 9kHz measurement</li> <li>● Frequency measurement of voltage and current from 2 kHz to 9 kHz</li> </ul> 40.96kHz sampling oscilloscope recorder	B0 B1
Option communication protocol <ul style="list-style-type: none"> <li>● Modbus RTU &amp; TCP</li> <li>● IEC 60870-5-104 (RJ45)</li> <li>● IEC61850 (RJ45)</li> </ul>	P0 P1 P2
Operating instructions <ul style="list-style-type: none"> <li>● German</li> <li>● English</li> <li>● French</li> <li>● Spanish</li> <li>● Italian</li> <li>● Chinese</li> <li>● Russian</li> </ul>	G1 G2 G3 G4 G5 G6 G7

### 3.1 Option PQI-DA smart

Software WinPQ lite	Code
<b>Software WinPQ lite</b> For parameterising PQI-DE, as well as reading PQI-DE measurement data and online data as a single-user licence – <b>free of charge</b>	900.9086
<b>Expansion WinPQ lite</b> For calibration of the PQI-DE and test report creation	900.9287
WinPQ database	Code
<b>Software WinPQ</b> For parameterization, archiving and evaluation of PQI-D, PQI-DA, PQI-DA smart and PQI-DE measurement data with the following basic functions: <ul style="list-style-type: none"><li>● 32-bit/64-bit Windows program interface</li><li>● Database for saving the measured values per measuring point</li><li>● Data access via TCP/IP network</li><li>● Visualization option for all measured variables retrievable from a PQI-D, PQI-DA, PQI-DA smart and PQI-DE as a function of time and as a statistical variable</li><li>● Automatic reporting according to EN50160; IEC61000-2-2 / 2-4; IEEE519; etc.</li><li>● Automatic export functions (Comtrade, PQDif, ASCII, PDF) and fault report transmission</li><li>● One additional workstation license for one Windows user is included in the price</li></ul>	WinPQ
<b>Licences</b> <ul style="list-style-type: none"><li>● as single-user license for 2 PQ measuring instruments (PQI-D, PQI-DA, PQI-DA smart, PQI-DE)</li><li>● as single-user license for 2 to 10 PQ measuring instruments (PQI-D, PQI-DA, PQI-DA smart, PQI-DE)</li><li>● as single-user license for &gt; 10 PQ measuring instruments (PQI-D, PQI-DA, PQI-DA smart, PQI-DE)</li><li>● as single-user license for &gt; 100 PQ measuring instruments (PQI-D, PQI-DA, PQI-DA smart, PQI-DE)</li></ul>	L0 L1 L2 L3
<b>Operating instructions</b> <ul style="list-style-type: none"><li>● German</li><li>● English</li></ul>	A1 A2
PQI-DA smart	Code
<b>SD-memory card (external): 4 GByte industrial standard</b>	900.9099.04
<b>Frame for panel mounting</b> DIN-rail, wall mounted housing	564.0435 564.0433
<b>Radio time clock interface DFC 77</b>	111.9024.01
<b>GPS-Clock – Navilog Set - RS485 . DIN-Rail</b> GPS receiver, GPS converter 5m connection cable, mounting bracket	111.7083
<b>Power supply for Navilog (DIN rail power supply, 88-264VAC/24V, 10W)</b>	111.7079
<b>Rogowski Coil for C40; 1..3000A; 85mV/1000A; 10Hz..20kHz; 15m connection cable; one piece</b>	111.7087
<b>Current clamp for C44 high accurate for secondary measurement circuits</b> 0...5A; 100mV/A; 10Hz..10kHz; 10m connection cable; one piece	111.7095

**A. Eberle GmbH & Co. KG**

Frankenstraße 160  
D-90461 Nuremberg

Tel.: +49 (0) 911 / 62 81 08-0  
Fax: +49-(0)911-62 81 08 99  
E-mail: info@a-eberle.de

<http://www.a-eberle.de>

Presented by:

---

**Copyright 2017 by A. Eberle GmbH & Co. KG**  
Subject to change without prior notice.

**Version: 03/6/2020 8:35 AM**